


Please Note: Fabrication will not begin until this drawing is approved, signed and returned to HCI


- ☐ APPROVED
☐ APPROVED AS NOTED
☐ REJECTED
☐ REVISE AND RESUBMIT

By _____

Date _____

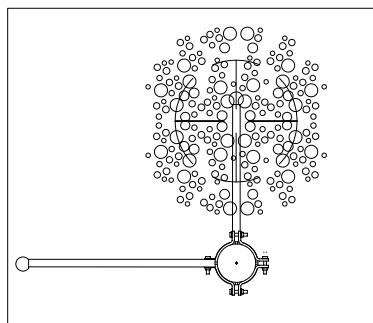

FLOWER BASKET BRACKET
AND BANNER ARM ORIENTATION
(TOP VIEW)

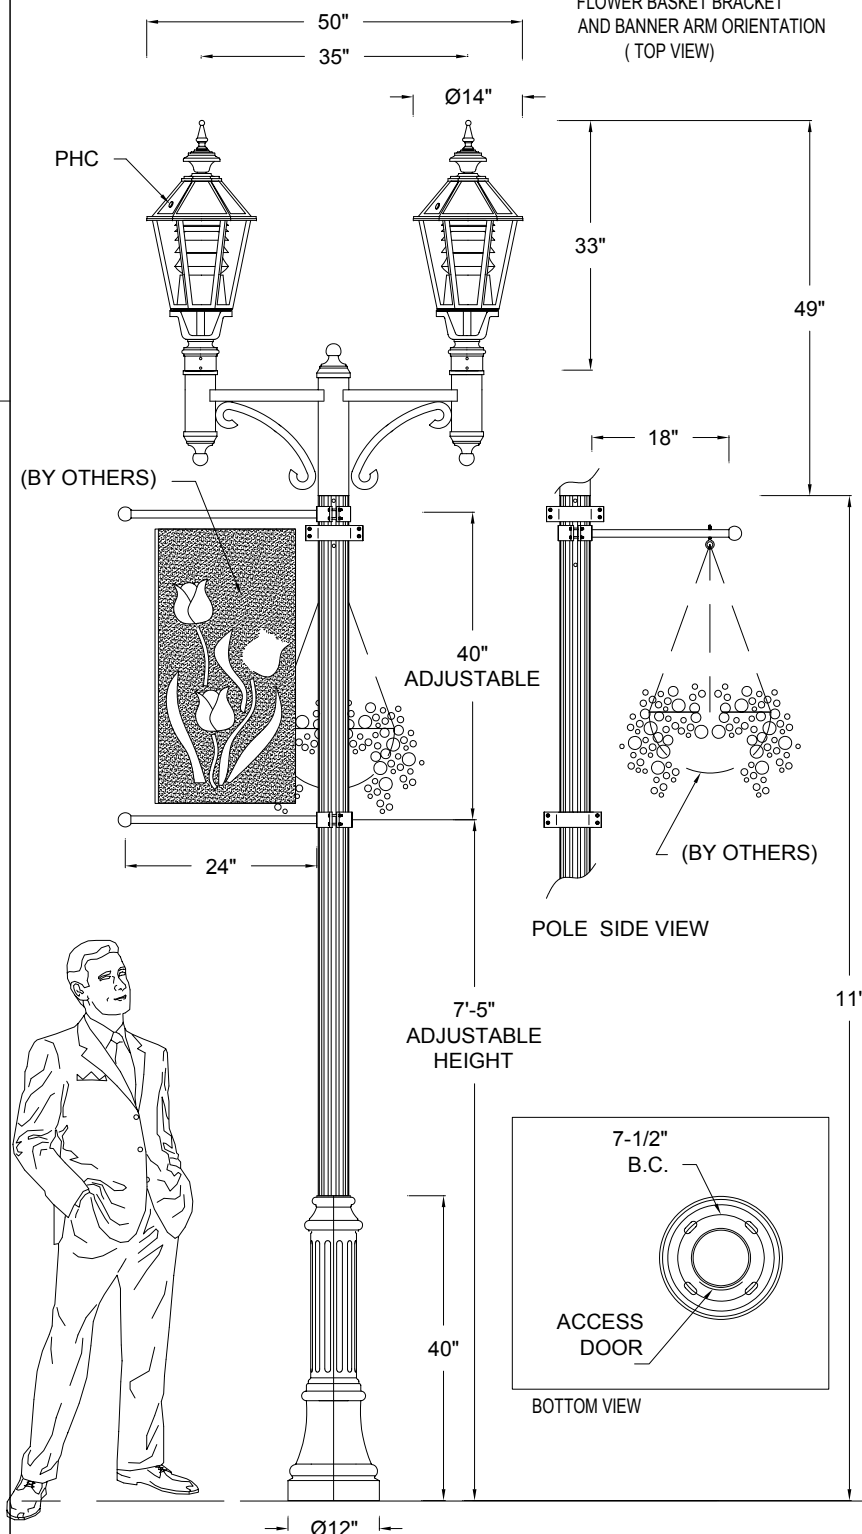

Approval Drawing

Light Std: F140-S-A304-2A-P416-4F

Diffuser Type: Clear.

Diffuser Material: Tempered Glass.

Optical System: Highly polished, multi louvered low-glare reflector. IES Type V.

Luminaire Housing: The whole luminaire is made of cast aluminum. Top is fully hinged for easy access to lamp and ballast.

Ballast: MH high power factor mounted on removable plate. A quick disconnect wiring system allows for fast easy ballast maintenance.

Wattage - 70W

Voltage - 120V

Socket - Medium (4KV).

Photocontrol: Luminaire intergrated button type photocell 120V.

Pole: Extruded fluted aluminum 4"OD x .250" (6.5mm) thick.

Base Cover: Two-piece cast aluminum attached to pole with four stainless steel screws.

Anchor bolts: 4 galvanized 3/4" (19mm) x 24" (610mm) long.

Anchor bolts and metal template are supplied by HCI.

Banner arm: Steel tube 1" (26mm) O.D. by 1/8" (3mm) thick with removable cast aluminum ball 2" Dia.

Flower Basket Bracket: Steel tube 1" (26mm)O.D. by 1/8"(3mm) thick shall be welded to a post clamp, which will fit to the pole.

Finish:Electrostatically applied, thermoset polyester powder-coat finish with XL4 four part corrosion inhibiting process.

Colour: Black RAL #9011

Date: Feb.12.2003 Drawing No: 4219 F
 Model: F140-S- CGL-70MH-120V-LV-5-PCB1-L-
 -A304-2A-FBC1-P416-4F-11-RAL9011
 Project: Danforth by the Valley

Please Note: Fabrication will not begin until this drawing is approved, signed and returned to HCI



1280 Fewster Drive, Mississauga, Ontario, Canada L4W 1A4
 Tel: (905) 238-2648 Fax: (905) 238-9060
 Toll Free Canada & USA 1-800-267-3175
 E: sales@hclighting.com WEB: www.hclighting.com